

LEGEND

- District Service Boundary
- District Per Metro-RLIS (6/17)
- Pressure Zone Boundary
- Lake Oswego
- Tualatin
- Rivergrove City
- Ductile Iron Pipe or Other
- Asbestos Cement Pipe
- Fire Hydrant
- Intertie
- Private Well
- Sample Station
- Blowoff
- Valve
- On Low Pressure System

DISTRIBUTION MAINS:

Size	Code
14"
12"
10"
8"
6"
4"
3"
2"

SOURCE WELLS:

Name	Nominal Pump Rate	Maximum Authorized Rate
No. 1	520 gpm (0.75 mgd)	600 gpm (1.34 cfs)
No. 2	370 gpm (0.53 mgd)	450 gpm (1.00 cfs)
Olson	350 gpm (0.50 mgd)	400 gpm (0.89 cfs)
Total	1,240 gpm (1.78 mgd)	1,450 gpm (3.23 cfs)


STORAGE RESERVOIRS:

Name	Capacity
No. 1	120,000 Gal.
No. 2	500,000 Gal.
No. 3	1,250,000 Gal.
Total	1,870,000 Gal.

ACTIVE SERVICES (1,380)

HYDRANT LEGEND:

- RGW Hydrants with Flow Data
- RGW Hydrants w/o Flow Data
- Lake Oswego Fire Hydrants
- Tualatin Fire Hydrants

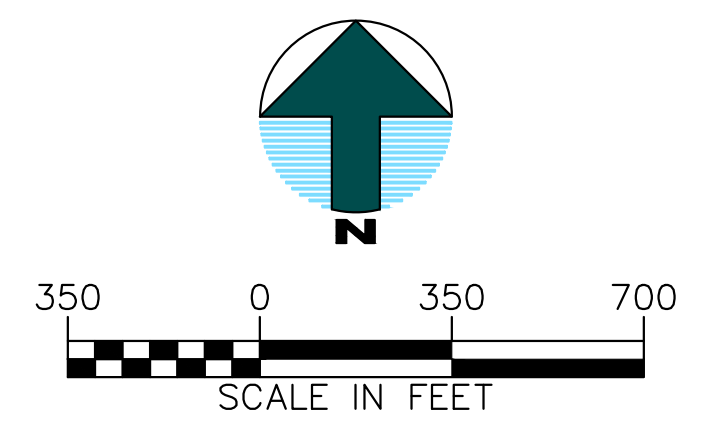

DISCLAIMER

THIS MAP IS FOR INFORMATIONAL PURPOSES ONLY AND HAS NOT BEEN PREPARED FOR OR IS SUITABLE FOR LEGAL, ENGINEERING OR SURVEYING PURPOSES. USERS OF THIS INFORMATION SHOULD REVIEW OR CONSULT THE PRIMARY DATA INFORMATION SOURCES TO ASCERTAIN THE USABILITY OF THE INFORMATION. THIS MAP REPRESENTS THE BEST DATA AVAILABLE AT THE TIME OF PUBLICATION. WHILE REASONABLE EFFORT HAS BEEN MADE TO INSURE THE ACCURACY OF THE INFORMATION SHOWN ON THIS PAGE, RIVERGROVE WATER DISTRICT ASSUMES NO RESPONSIBILITY OR LIABILITY FOR ANY ERRORS, OMISSIONS, OR USE OF THIS INFORMATION.

U:\Data\RCWD\System Maps\CAD\07-0876-401-OR-MAP-22-RH2.dwg 350 SCALE 10/25/2024 10:15 AM PLAU